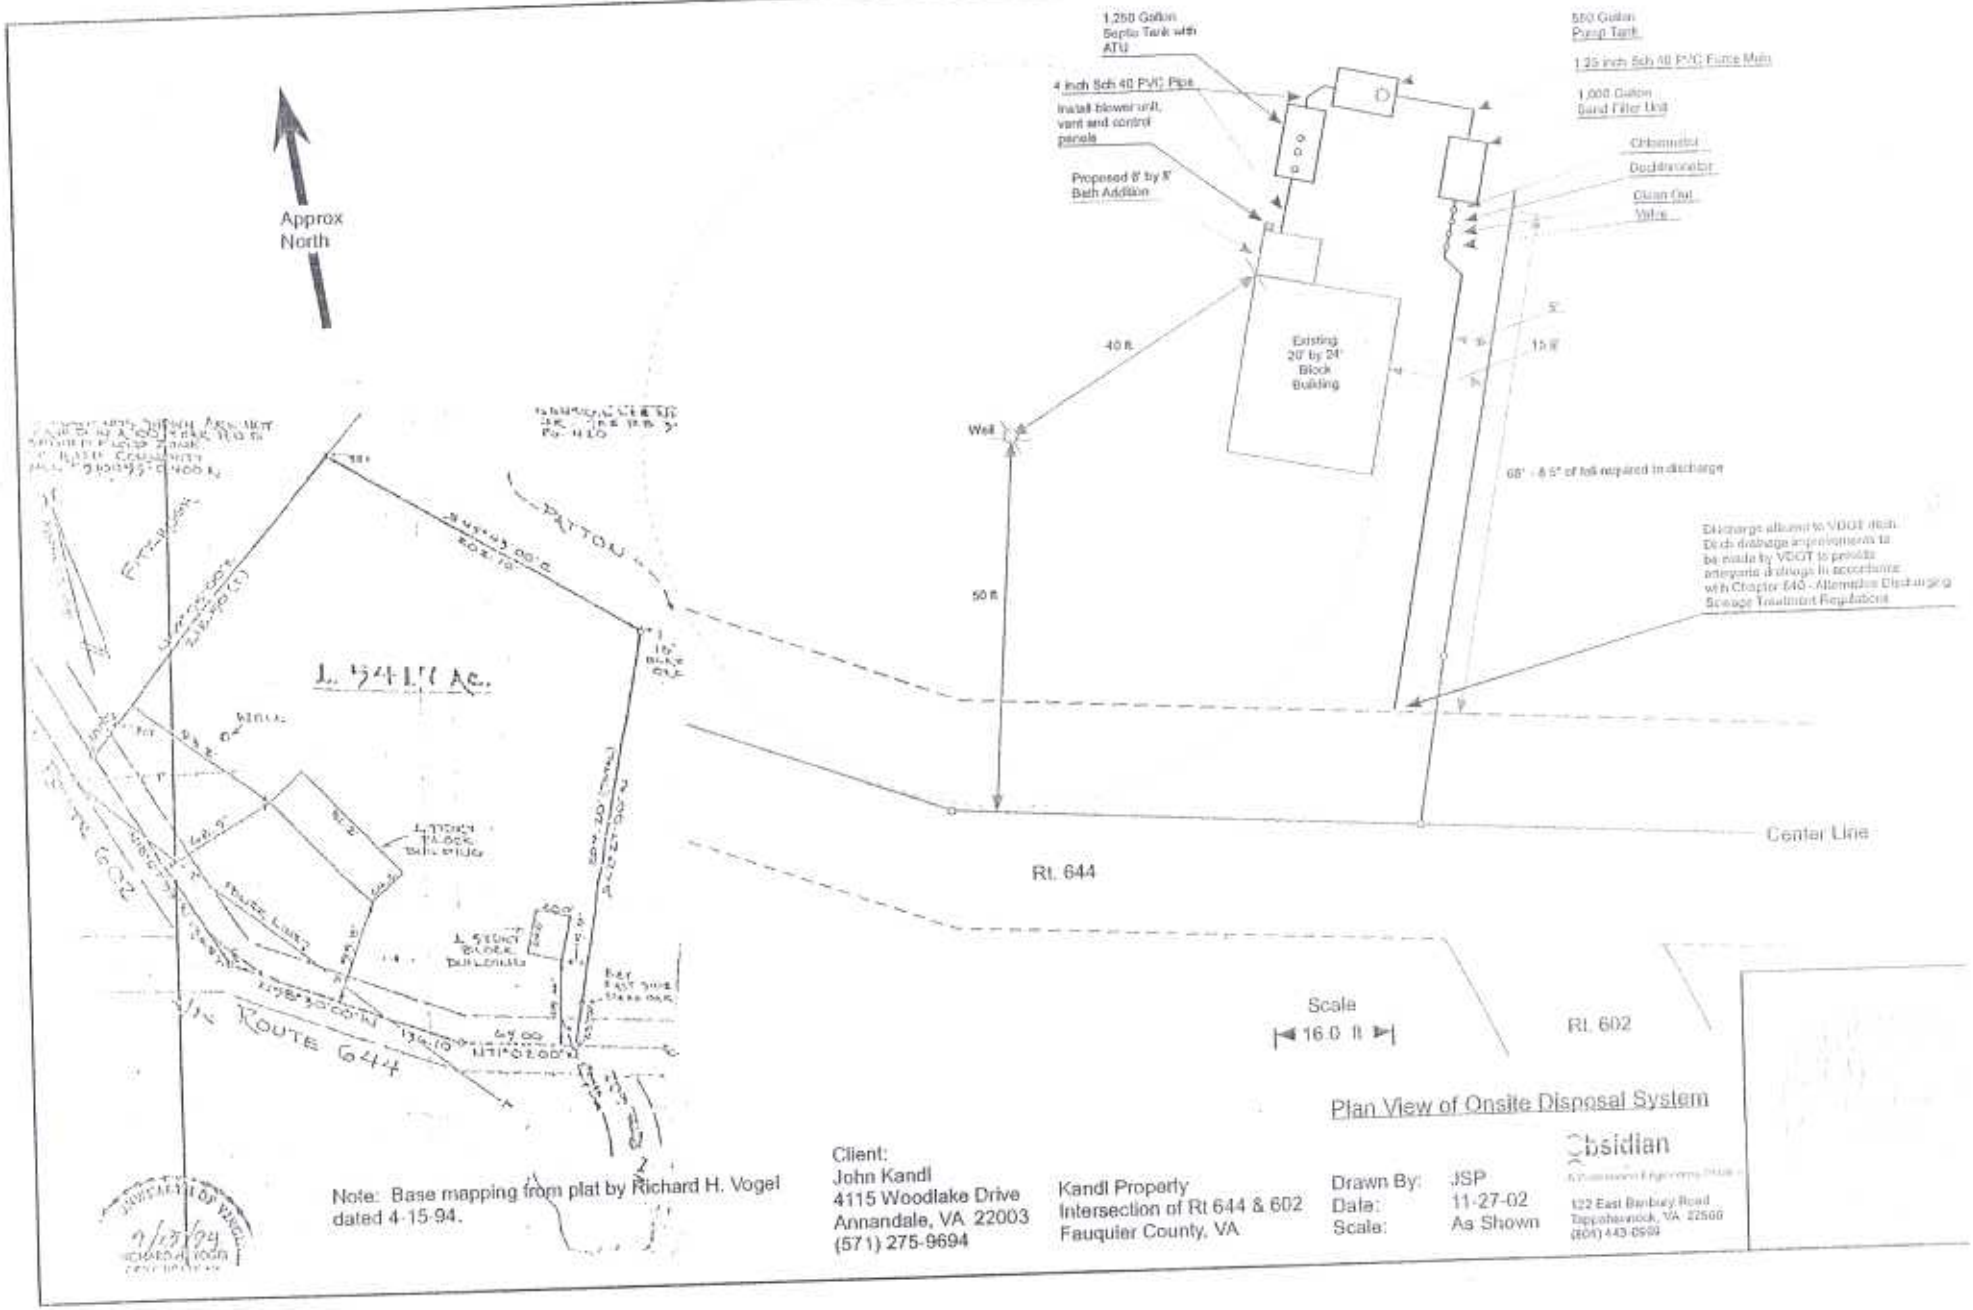

Approx North
1,250 Gallon Septic Tank with ATU
4 inch Sch 40 PVC Pipe
Install blower unit, vent and control panels
Proposed 8' by 8' Bath Addition
550 Gallon Pump Tank
1.25 inch Sch 40 PVC Force Main
1,000 Gallon Sand Filter Unit
Chlorinator
Dechlorinator
Clean Out
Valve
Existing 20' by 24' Block Building
40 ft
Well
50 ft
5'
15 ft
68' - 8.5' of fall required in discharge
Discharge allowed to VDOT ditch. Ditch drainage improvements to be made by VDOT to provide adequate drainage in accordance with Chapter 640 - Alternative Discharging Sewage Treatment Regulations
Center Line
Rt. 644
Rt. 602
Scale
16.0 ft
L. 5417 Ac.
PATTON
ROUTE 644
Plan View of Onsite Disposal System
Obsidian
122 East Banbury Road
Tappahannock, VA 22560
(804) 443-0909
Note: Base mapping from plat by Richard H. Vogel dated 4-15-94.
Client:
John Kandl
4115 Woodlake Drive
Annandale, VA 22003
(571) 275-9694
Kandl Property
Intersection of Rt 644 & 602
Fauquier County, VA
Drawn By: JSP
Date: 11-27-02
Scale: As Shown