PUMPING TEST of WELL MS-5, BEALETON SERVICE DISTRICT, BEALETON, VIRGINIA

Pumping Test Yield of Well MS-5 was 135 to 140 gallons per minute.

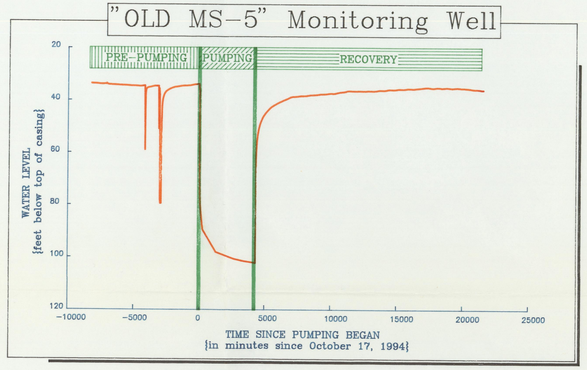

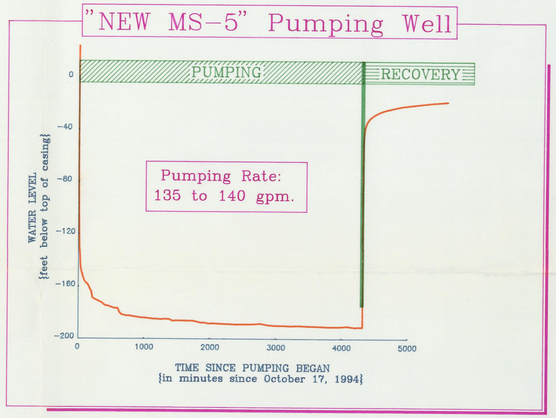

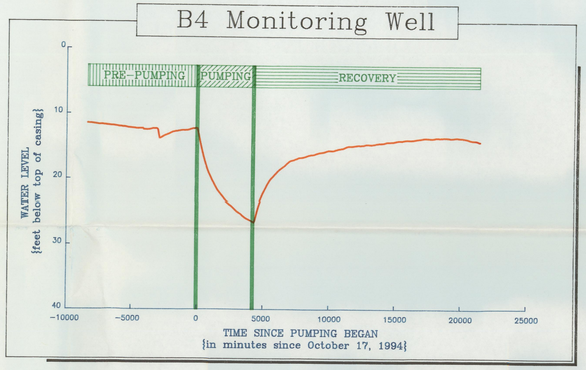

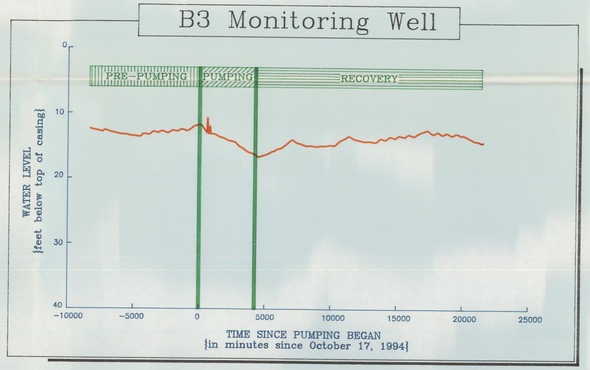

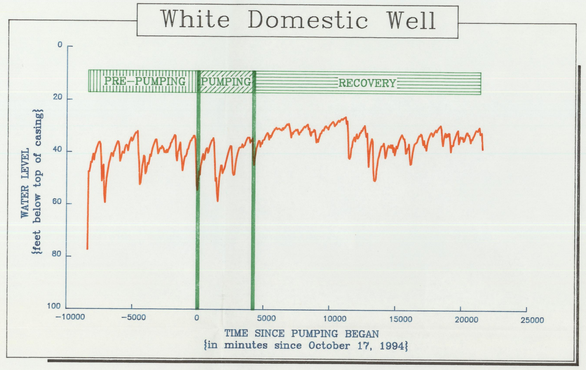

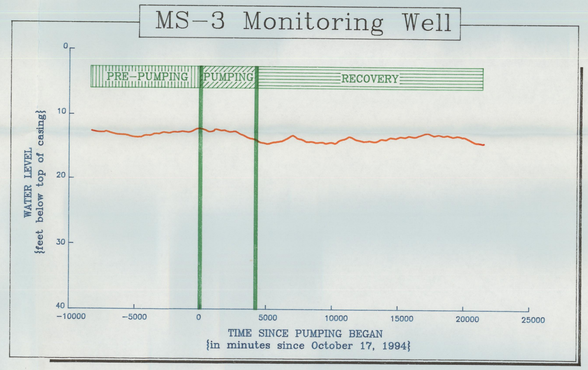

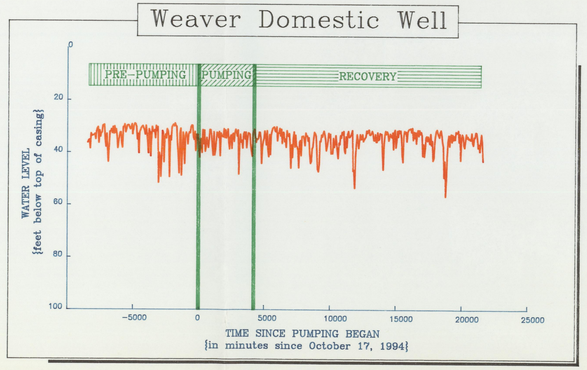

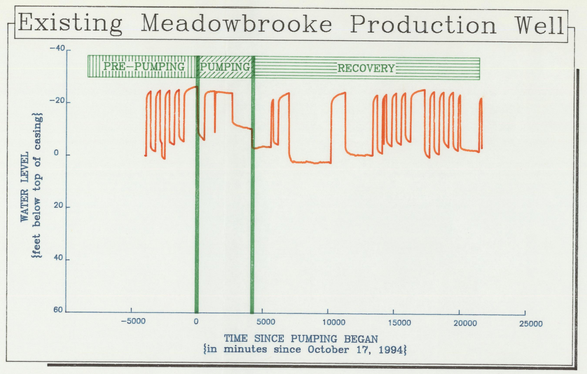

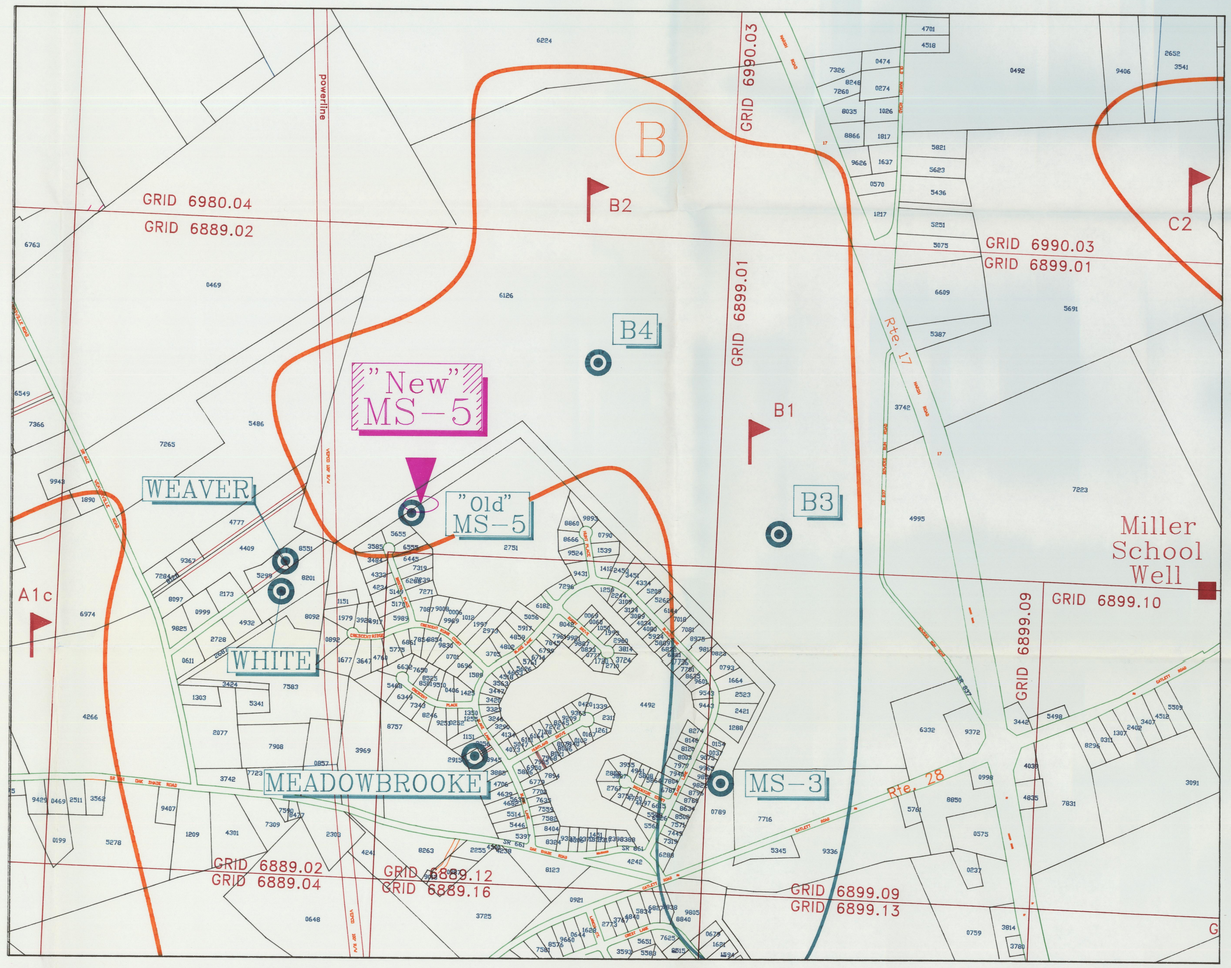

Scale is 1" = 500' (1:6000)

B1 Monitoring Well

B3 Pumping Well

FAVORABLE ZONE KEY

Primary Favorable Zone

Test Well Site

Number designation does imply priority for drilling.

Letter designation does not imply priority of favorability.

Secondary Portion of the Favorable Zone

Cultural Data from Fauquier County's GIS

GIS Grid Line & Number

Property Line

Road In GIS

Road Name

GIS PIN

GN

MN 9° 30'

N

UTM zone 18

PUMPING TEST RESULTS
BEALETON, VIRGINIA

LOCAL WATER LEVEL RESPONSES DURING LONG-TERM PUMPING TEST of WELL MS-5

Job Number:	Date:	
VA08991606J	Dec., 1994	PLATE 2

Emery & Garrett Groundwater, Inc.
170 Waukewan Road
Meredith, NH 03253
Chantilly, VA Waterville, ME