APPROXIMATED ZONES OF INFLUENCE ASSOCIATED WITH PUMPING OF WELLS B3, B4, and MS-5

A APPROXIMATED ZONE OF INFLUENCE ASSOCIATED WITH THE PUMPING OF WELLS B3 and B4

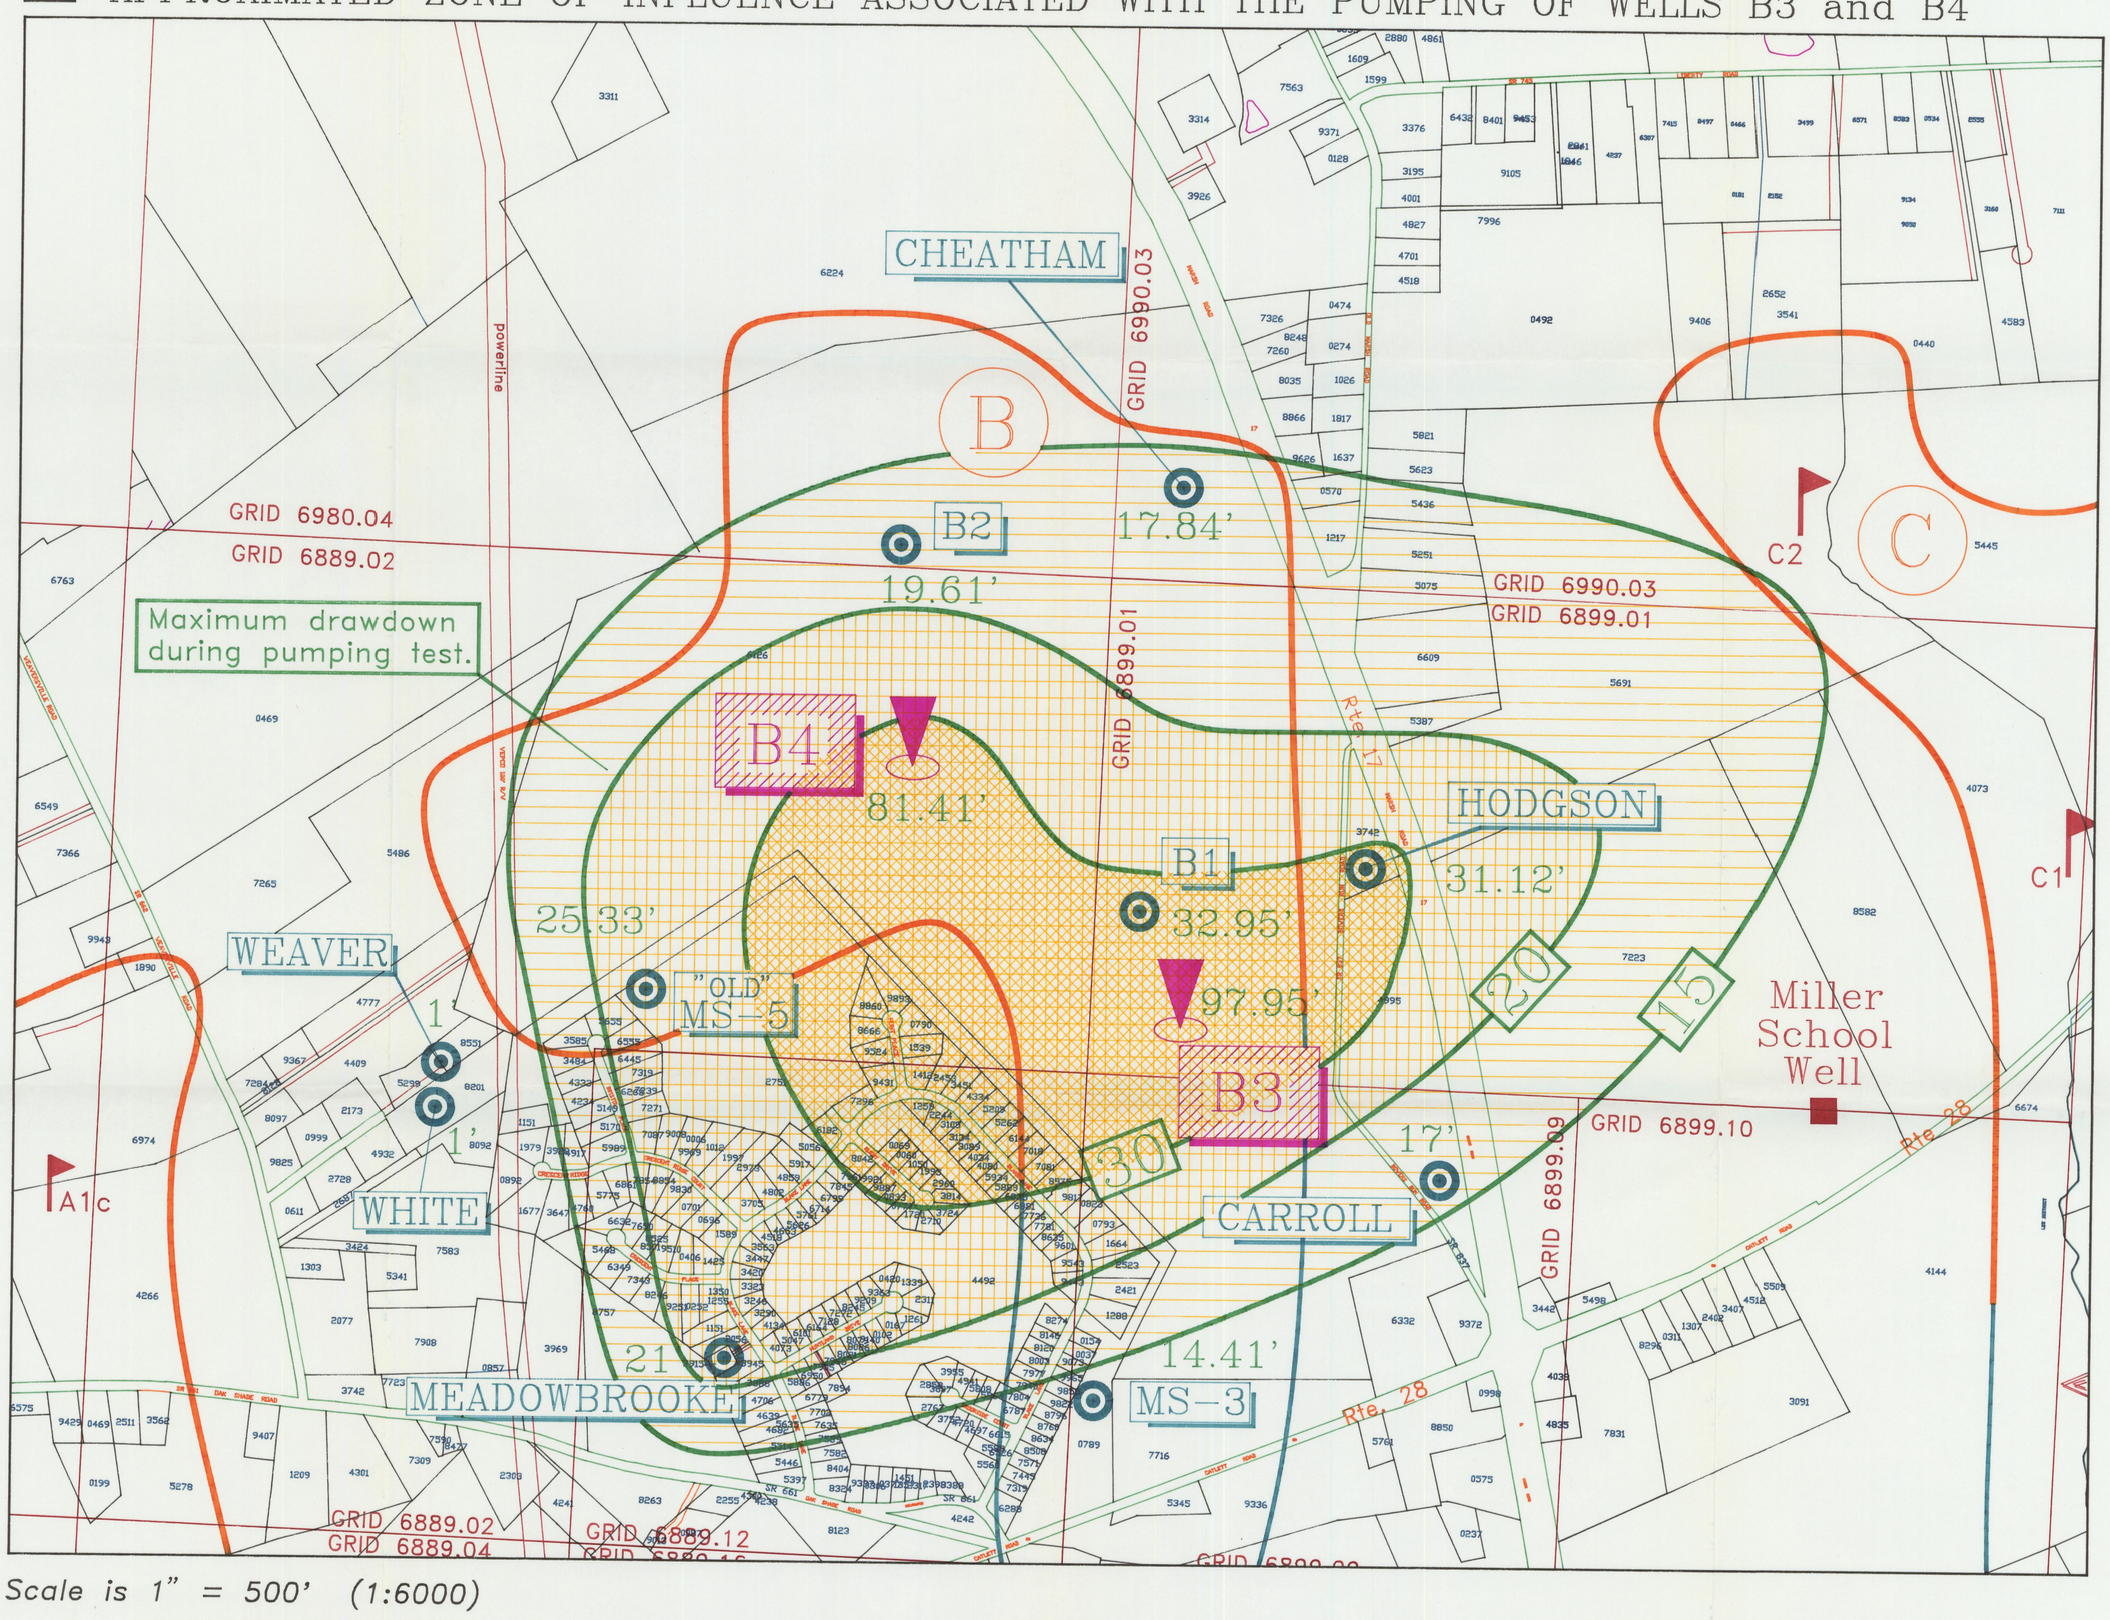

Scale is 1" = 500' (1:6000)

B APPROXIMATED ZONE OF INFLUENCE ASSOCIATED WITH THE PUMPING OF WELL MS-5

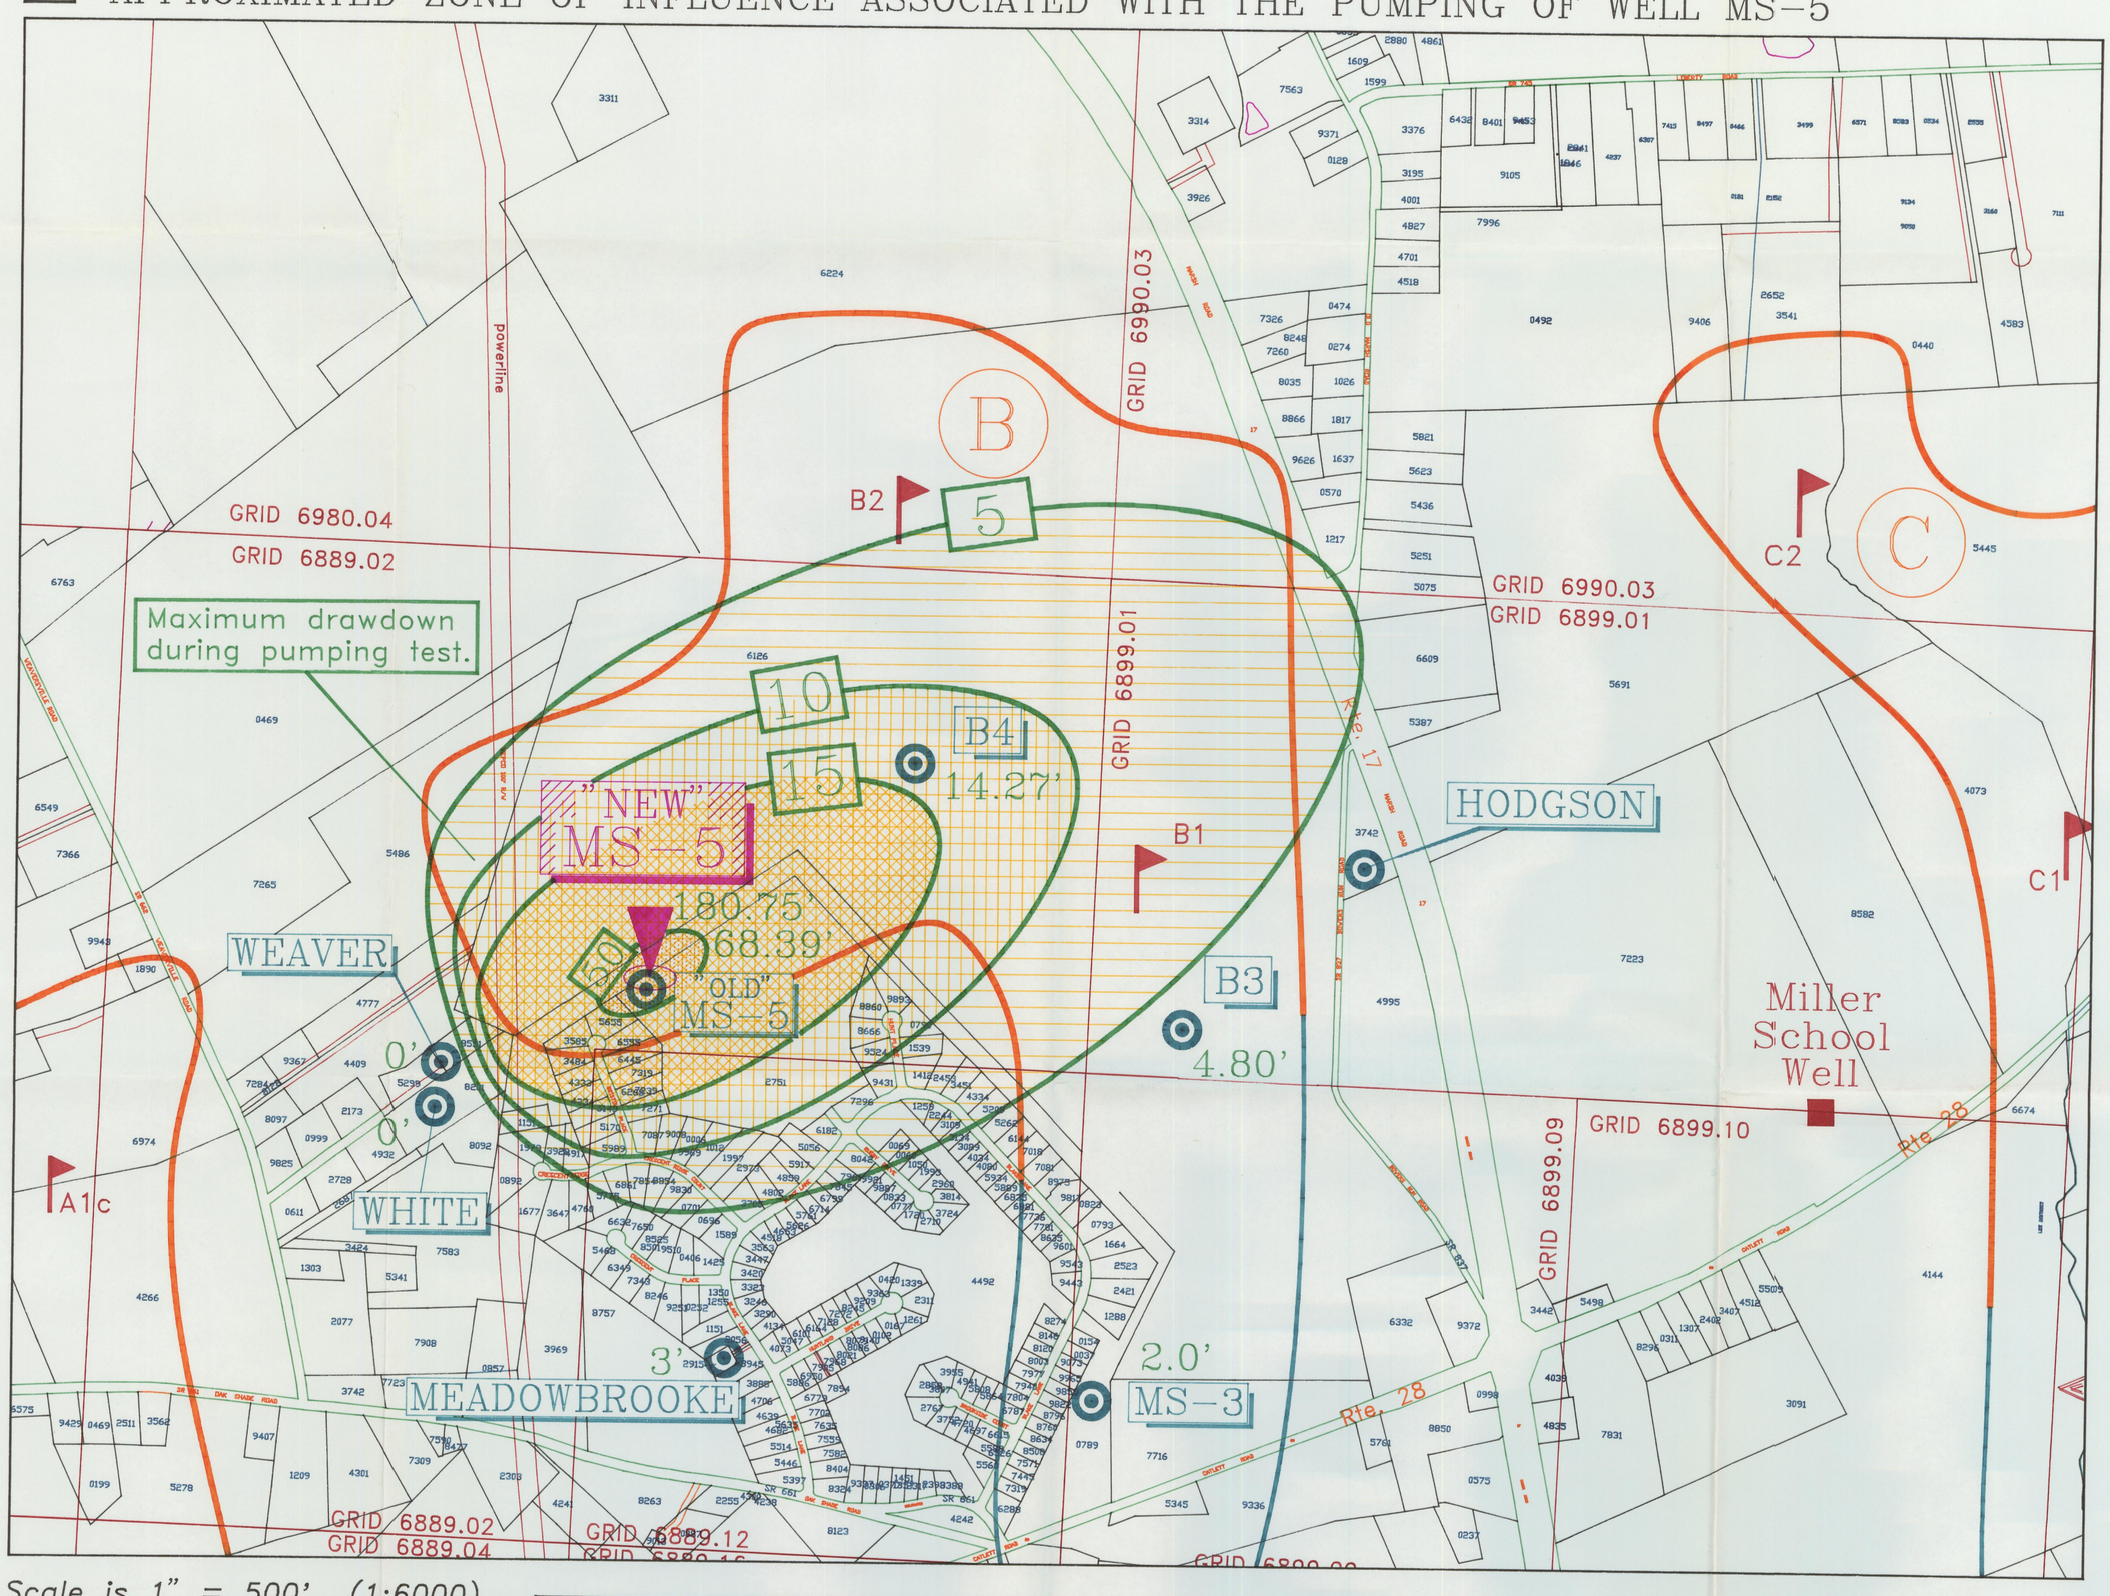

Scale is 1" = 500' (1:6000)

B1 Monitoring Well

32.95' Maximum drawdown during pumping test.

B3 Pumping Well

FAVORABLE ZONE KEY

Primary Favorable Zone

A1 Test Well Site

A

Secondary Portion of the Favorable Zone

Number designation does imply priority for drilling.

Letter designation does not imply priority of favorability.

Cultural Data from Fauquier County's GIS

GIS Grid Line & Number

Property Line

Road in GIS

Road Name

GIS PIN

GN

MN 6° 20'

TN 1° 40'

UTM zone 18

PUMPING TEST RESULTS

APPROXIMATED ZONES of INFLUENCE DURING PUMPING TESTS of WELLS B3, B4, and MS-5

Job Number:	Date:	
VA0891606J	Dec., 1994	PLATE 3

Emery & Garrett Groundwater, Inc.
170 Waukewan Road
Meredith, NH 03253
Chantilly, VA Waterville, ME